



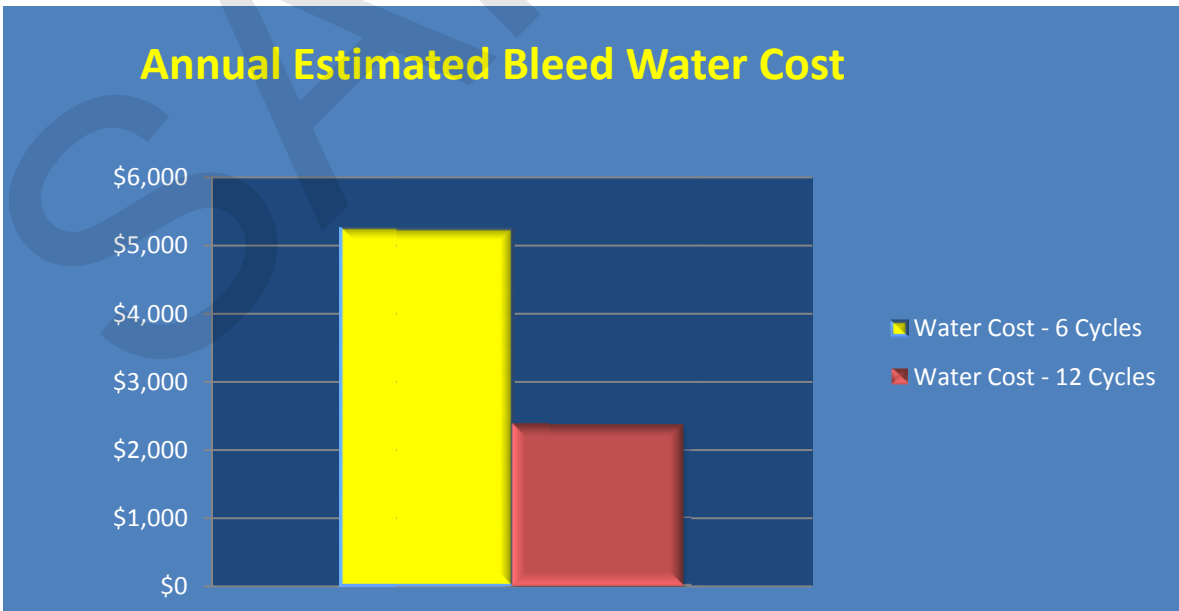

**Aqualine Water Treatment Products Inc.**  
710 Northeast Drive, Suite 10  
Davidson, NC 28036

Phone 704-895-5500 - Fax 704-895-5501

**Projected Cooling Tower Water Savings Analysis for:  
800 Ton System**  
Charlotte, NC 28202

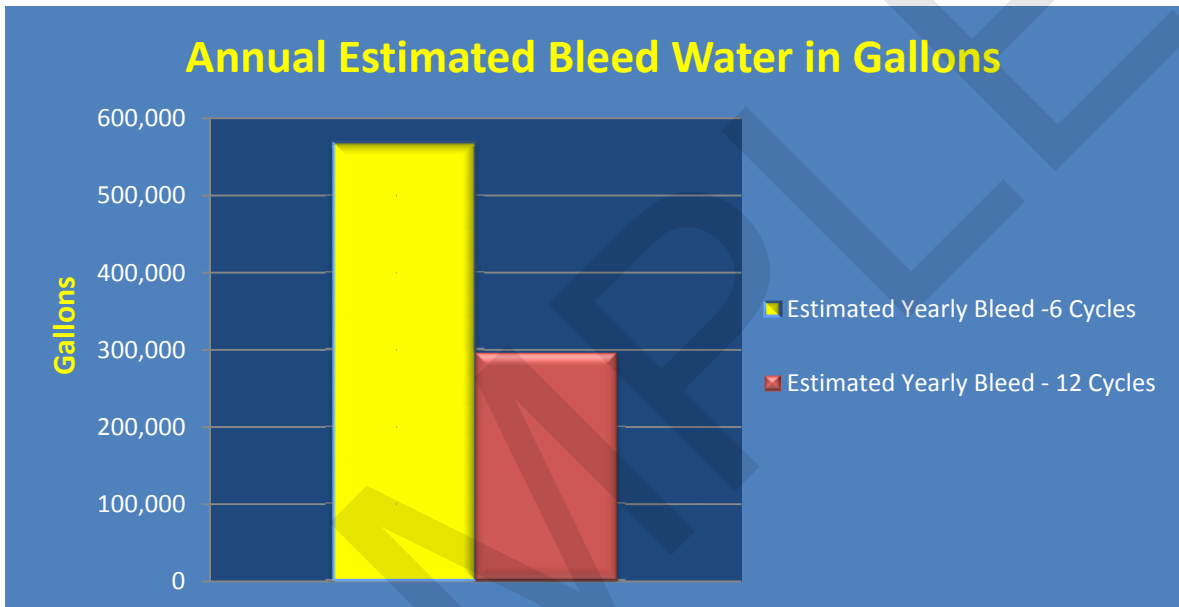





**Aqualine Water Treatment Products Inc.**  
**710 Northeast Drive, Suite 10**  
**Davidson, NC 28036**

**Phone 704-895-5500 - Fax 704-895-5501**

### Annual Projected Water Cost Savings vs. High Performance Chemistry Cost

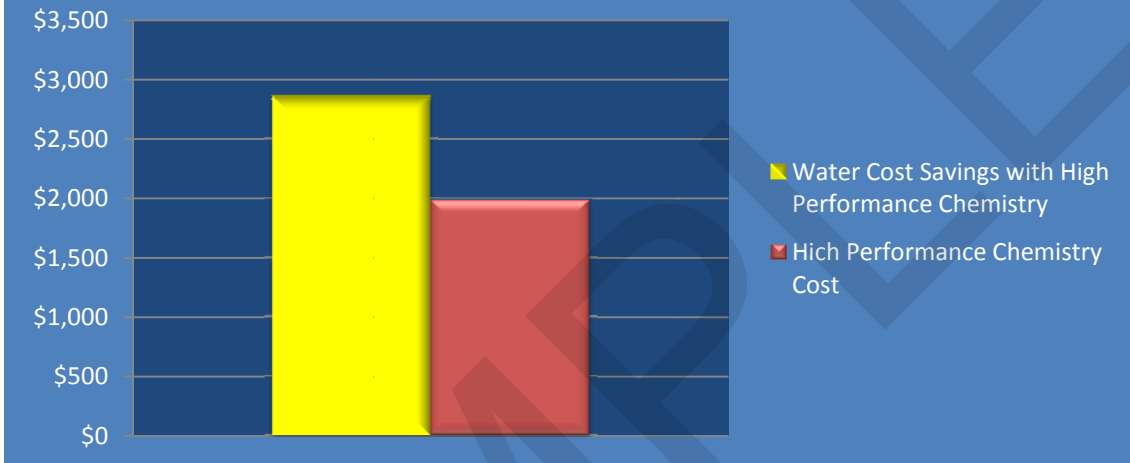

### Annual Projected Cost Reduction to Owner

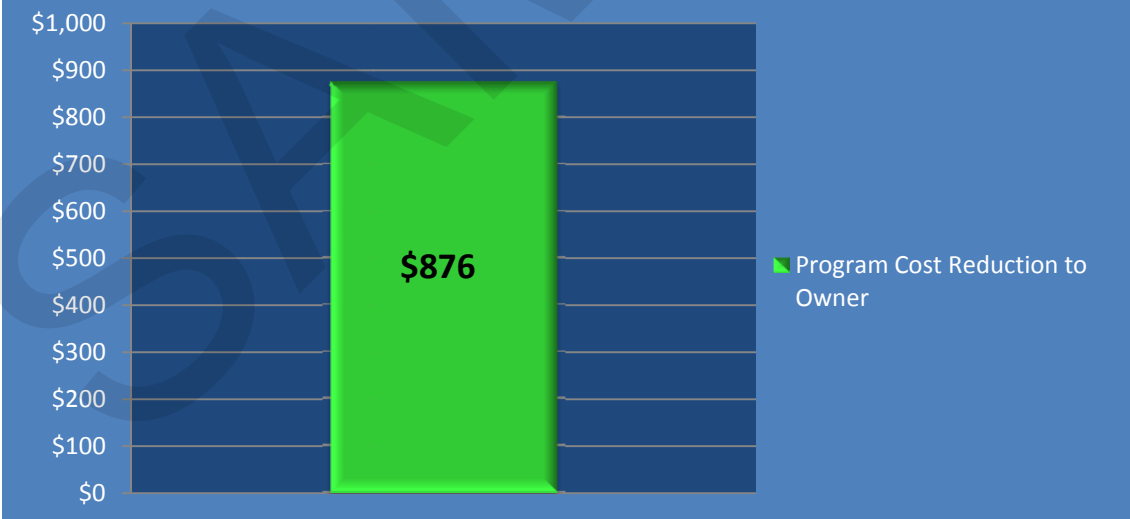

Analysis based on:

>Yearly cooling tower makeup of 3,896 K Gallons per year

>Commercial cost of water in Mecklenburg County:

- Flat usage charge of \$2.04 per Ccf of metered water usage
- Administrative charge for sewer \$.06 per day per sewer service
- Sewer usage charge of \$4.0 per Ccf of metered water usage

>Aqualine's projected water management program due to changes in chemistry